



BUILDING CODE COMPLIANCE OFFICE (BCCO)  
 PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA  
 METRO-DADE FLAGLER BUILDING  
 140 WEST FLAGLER STREET, SUITE 1603  
 MIAMI, FLORIDA 33130-1563  
 (305) 375-2901 FAX (305) 375-2908

**NOTICE OF ACCEPTANCE (NOA)**

**Santafe Tile Corporation**  
 8825 NW 95<sup>th</sup> Street  
 Medley, FL 33178

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by the BCCO and accepted by the Building Code and Product Review Committee to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Mission Barrel "Roofing Tile"**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This renews NOA 03-0114.06 and consists of pages 1 through 5.  
 The submitted documentation was reviewed by Alex Tigera.



NOA No.: 07-0626.04  
 Expiration Date: 10/13/12  
 Approval Date: 10/04/07  
 Page 1 of 5

## ROOFING ASSEMBLY APPROVAL

**Category:** Roofing  
**Sub-Category:** 07320 Roofing Tiles  
**Material:** Clay  
**Deck Type:** Wood

### 1. SCOPE

This renews a roofing system using Santafe 'Mission Barrell', as manufactured Santafe Tile Corporation in Bogota, Colombia and as described in Section 2 of this Notice of Acceptance. For locations where the pressure requirements, as determined by applicable Building code does not exceed the values listed in Section 4 herein. The attachment calculations shall be done as a moment based system.

### 2. PRODUCT DESCRIPTION

| <u>Manufactured by Applicant</u> | <u>Dimensions</u>                                    | <u>Test Specifications</u> | <u>Product Description</u>   |
|----------------------------------|--|----------------------------|--|
| Mission Barrel Clay Roof Tile    | L = 18"<br>W = tapered 7.5" to 9"                    | TAS 112                    | High profile, two piece, tapered clay roof tile equipped with one nail holes. For nail-on with clip, mortar set and adhesive set applications. |
| Trim Pieces                      | Length: varies<br>Width: varies<br>Varying thickness | TAS 112                    | Accessory trim, clay roof pieces for use at hips, rakes, ridges and valley terminations. Manufactured for each tile profile.                   |

#### 2.1 SUBMITTED EVIDENCE:

| <u>Test Agency</u>                       | <u>Test Identifier</u>           | <u>Test Name/Report</u> | <u>Date</u> |
|--|----------------------------------|-------------------------|-------------|
| The Center for Applied Engineering, Inc. | 94-156-5<br>94-156-6             | TAS 101<br>TAS 102      | Aug. 1994   |
| The Center for Applied Engineering, Inc. | 25-7121-1                        | TAS 101                 | Nov. 1995   |
| The Center for Applied Engineering, Inc. | Project: 07-07-00-91<br>(307023) | TAS 100                 | Sept. 1994  |
| IBA Consultants                          | 2353-126                         | ASTM C 1167             | June 2007   |
| PRI Asphalt Technologies, Inc.           | SFTC-001-02-01                   | TAS 101                 | Dec. 2002   |



NOA No.: 07-0626.04  
 Expiration Date: 10/13/12  
 Approval Date: 10/04/07  
 Page 2 of 5

### 3. LIMITATIONS

- 3.1 Fire classification is not part of this acceptance.
- 3.2 For mortar or adhesive set tile applications, a static field uplift test in accordance with RAS 106 may be required, refer to applicable building code.
- 3.3 Applicant shall retain the services of a Miami-Dade county Certified Laboratory to perform quarterly tests in accordance with TAS 112, appendix 'A'. Such testing shall be submitted to the Building Code Compliance Office for review.
- 3.4 Minimum underlayment shall be in compliance with the applicable Roofing Application Standard listed section 4.1 herein.
- 3.5 30/90 hot mopped underlayment applications may be installed perpendicular to the roof slope unless stated otherwise by the underlayment material manufacturers published literature.
- 3.6 This acceptance is for wood deck applications. Minimum deck requirements shall be in compliance with applicable building code.

### 4. INSTALLATION

- 4.1 SantaFe 'Mission Barrel' and its components shall be installed in strict compliance with Miami Dade County Roofing Application Standard RAS 118, RAS 119, and RAS 120.
- 4.2 Data For Attachment Calculations

| Table 1: Average Weight (W) and Dimensions (l x w) |                |                   |                |
|--|----------------|-------------------|----------------|
| Tile Profile                                       | Weight-W (lbf) | Length - l (feet) | Width-w (feet) |
| Mission Barrel Clay Roof Tile                      | 5.50           | 1.50              | 0.68           |

| Table 2: Aerodynamic Multipliers - $\lambda$ (ft <sup>3</sup> ) |   |
|---|---|
| Tile Profile  | $\lambda$ (ft <sup>3</sup> )<br>Direct Deck Application |
| Mission Barrel Clay Roof Tile                                   | 0.242   |

| Table 3: Restoring Moments due to Gravity - $M_g$ (ft-lbf) |        |        |        |        |                   |
|--|--------|--------|--------|--------|-------------------|
| Tile Profile   | 3":12" | 4":12" | 5":12" | 6":12" | 7":12" or greater |
| Mission Barrel Clay Roof Tile                              | 6.25   | 6.20   | 6.11   | 6.00   | 5.87              |

| Table 4: Attachment Resistance Expressed as a Moment - $M_r$ (ft-lbf) |                            |                               |
|---|----------------------------|-------------------------------|
| Tile Profile  | Tile Application           | Minimum Attachment Resistance |
| Mission Barrel Clay Roof Tile   | Nail-on With A Clip System | 24.1                          |

- 1. The nail hole shall be located at the center of the cover tile, 1-1/2" from the head.
- 2. Minimum 3" headlap.



| Table 5: Attachment Resistance Expressed as a Moment - $M_f$ (ft-lbf)<br>for Single Patty Adhesive Set Systems |                   |                               |
|--|-------------------|-------------------------------|
| Tile Profile   | Tile Application  | Minimum Attachment Resistance |
| Mission Barrel Clay Roof Tile  | Polyfoam PolyPro™ | 141.8 <sup>3</sup>            |
| 3 Place 35 grams per pan and 35 grams per cap of PolyPro™.   |                   |                               |

| Table 5A: Attachment Resistance Expressed as a Moment - $M_f$ (ft-lbf)<br>for Mortar Set Systems |                         |                       |
|--|-------------------------|-----------------------|
| Tile Profile   | Tile Application        | Attachment Resistance |
| Mission Barrel Clay Roof Tile  | Mortar Set <sup>1</sup> | 57.4                  |

## 5. LABELING

- 5.1 All tiles shall bear the imprint or identifiable marking of the manufacturer's name or logo, or following statement: "Miami-Dade County Product Control Approved".

# SANTAFE TM MADE IN COLOMBIA

IDENTIFICATION MARK FOR MISSION BARREL CLAY ROOF TILE  
(LOCATED UNDERNEATH TILE)


## 6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance.
  - 6.1.2 Any other documents required by the Building Official or applicable Building Code in order to properly evaluate the installation of this system.



NOA No.: 07-0626.04  
 Expiration Date: 10/13/12  
 Approval Date: 10/04/07  
 Page 4 of 5

**PROFILE DRAWING**

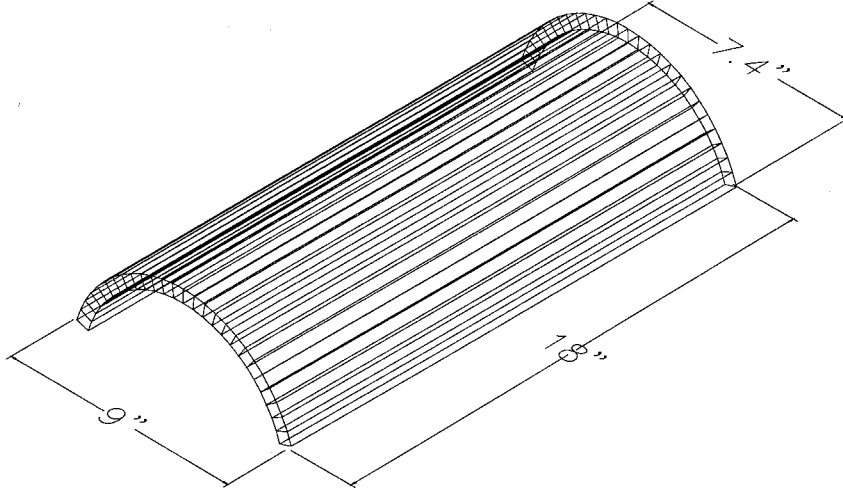

**SANTAFÉ "MISSION BARREL" CLAY ROOF TILE**

**END OF THIS ACCEPTANCE**



**NOA No.: 07-0626.04**  
**Expiration Date: 10/13/12**  
**Approval Date: 10/04/07**  
**Page 5 of 5**